

75


Stopseal[®] Batt

PyroPro HPE[®] Sealant

Copper Pipe

Elastomeric Insulation C/S

Supporting construction:
Flexible or rigid walls \geq 75mm

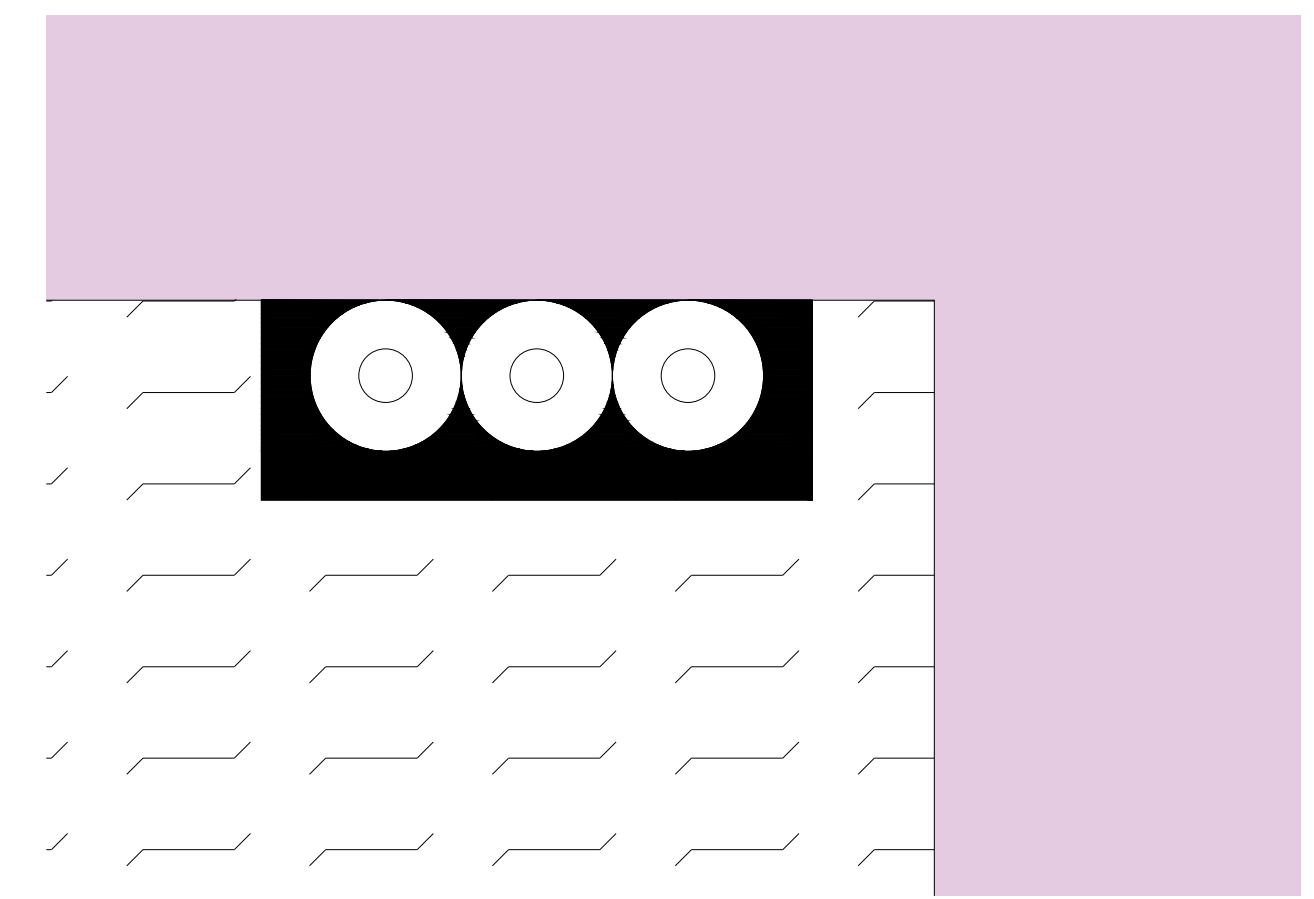

Technical Details

Supporting Test Data:

WF549799/R

Test Standard:

EN 1366-3

Fire Resistance Performance:

	Maximum Aperture size (mm)	
Copper pipes 22mm Ø, 1.0mm wall thickness 20mm thick elastomeric insulation C/S	1200 x 800	E60 EI30

Supporting Construction:

Flexible walls \geq 75mm - Framed and Lined
*The supporting construction must meet the fire resistance requirement of the proposed firestopping detail. Supporting construction must be installed and apertures formed in line with manufacturer's guidance

Service Supports:

$<$ 400mm
*Service supports must be appropriately fire resistant

Installation:

FSi Ltd. recommend installation of FSi Ltd. products is carried out by 3rd party certified installers.

The substrate must be clean, dry, sound and homogeneous, free from oils, grease, dust and loose particles.

Measure the size of the opening, relevant position and size of the services. Tape all surfaces where necessary to ensure the aesthetics of Pyrocoustic[®] Sealant. Draw these details onto the Stopseal[®] Batt and cut out using a saw or knife. Using a trowel or pallet knife apply a thick layer of Pyrocoustic[®] Sealant to all areas of contact around the opening and services. Apply a similar thickness of Pyrocoustic[®] Sealant to the cut Stopseal[®] Batt. Fit the cut Stopseal[®] Batt into the opening, ensuring a tight friction fit. Push the Stopseal[®] Batt firmly into the opening using the flat of the hand. Continue the above procedure to fill the opening ensuring that a layer of Pyrocoustic[®] Sealant is applied to all areas of contact between the boards. The seal should be made up from as few pieces of Stopseal[®] Batt as practicable. Any small gaps in the seal left when all cut pieces have been installed should be tightly packed with off-cuts and coated with Pyrocoustic[®] Sealant. A layer of Pyrocoustic[®] Sealant should be applied to all joint lines formed by piecing the seal together. To complete the installation a small bead of Pyrocoustic[®] Sealant should be applied around the extremities of the opening and services. The bead of Pyrocoustic[®] Sealant should be smoothed to overlap the wall surface by approximately 5mm. Remove any masking and dispose of waste materials.

PyroPro HPE[®] Sealant installed to the full depth of the Stopseal[®] Batt within the 20mm annulus surrounding the combustible service penetration.

Minimum Separation Between Services of the Same Type:
0mm


Minimum Separation to edge:
0mm

Maximum Opening Size:
1200mm x 800mm

Issue No.	Drawing Reference	Date
01	STOP-108	24/07/2025

TESTED DETAIL

Drawing Title: Stopseal[®] Batt system installed to metal pipe with elastomeric insulation sealed with PyroPro[®] HPE Sealant through a single skin flexible wall construction.

Scale : NTS	FSi Limited Westminster Industrial Estate Tamworth Road Measham Leicestershire DE12 7DS
Drawn by : FSi Limited	
Reviewed by : N/A	

FSi Ltd. products are manufactured to rigid standards of quality. No liability can be accepted for the information provided in this document although it is published in good faith and believed to be correct at time of issue. Any drawings provided are for illustrative purposes only. FSi Ltd. reserves the right to alter product specifications without prior notice, in line with our Company policy of continuous development and improvement. Changes due to new findings are possible, errors and misprints are not excluded. No liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given. FSi Ltd. have no control over the methods of installation, competence of operatives or suitability of site condition. No warranties, expressed or implied, are intended to be given as to the actual performance of the product/system mentioned within this document.